


ELEVATION VIEW

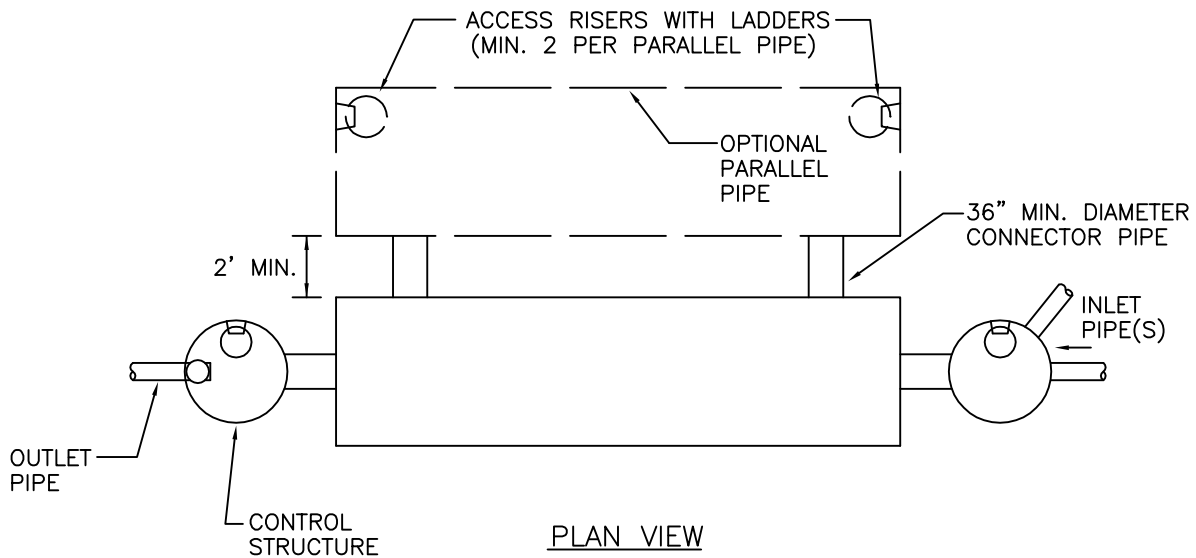

PLAN VIEW

NOTES:

1. NEOPRENE GASKETS REQUIRED AT ALL CMP AND CPE PIPE JOINTS.
2. SHEAR GATE REQUIRED FOR ALL SYSTEMS TO BE MAINTAINED BY THE CITY.
3. FOR DEAD STORAGE GREATER THAN 1', PROVIDE GRAVITY DRAIN (4" MINIMUM DIAMETER) TO REDUCE DEPTH TO 1' OR LESS FOR MAINTENANCE PURPOSES.
4. ALL METAL PARTS CORROSION RESISTANT. STEEL PARTS GALVANIZED AND ASPHALT COATED (TREATMENT 1 OR BETTER).
5. CAPACITY OF OUTLET PIPE MUST BE EQUAL TO OR GREATER THAN ALL SYSTEMS IN.

